


Connection cable voltage

For devices of the IKI series and ohmic sensors

This connection cable can be used to connect devices of the IKI-50 series to sensors (For the connection to the ohmic sensor, a coaxial cable set is additionally required).

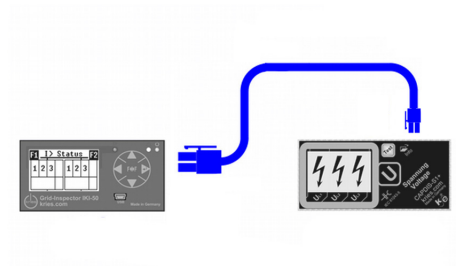

Features

For connecting IKI devices to CAPDIS-PI (angled system connector)

Versions

Item number	Description
2500511	Y-cable IKI to CAPDIS-PI-RR4 1.5 m 2 x system plug
2500511_H002	Y-cable IKI to CAPDIS-PI-RR4 1.5 m 2 x system plug, decoupled
2500512	Y-cable IKI to CAPDIS-PI-RR4 3 m 2 x system plug
2500512_H002	Y-cable IKI to CAPDIS-PI-RR4 3 m 2 x system plug, decoupled
2500513	Y-cable IKI to CAPDIS-PI-RR4 10 m 2 x system plug
2500513_H002	Y-cable IKI to CAPDIS-PI-RR4 10 m 2 x system plug, decoupled
2500522	Y-cable IKI to CAPDIS-PI-RR4 0.5 m 2 x system plug
2500522_H002	Y-cable IKI to CAPDIS-PI-RR4 0.5 m 2 x system plug, decoupled
2501288	Y-cable IKI to CAPDIS-PI-RR4 1.5 m 2 x system plug
2501289	Y-cable IKI to CAPDIS-PI-RR4 0.3 m 2 x system plug
2501293	Y-cable IKI to CAPDIS-PI-RR4 3 m 2 x system plug
2502096	Y-cable adapter Sx to PI
2509384	Y-cable IKI to CAPDIS-PI-RR4 6 m 2 x system plug
2509384_H002	Y-cable IKI to CAPDIS-PI-RR4 6 m 2 x system plug, decoupled

Technical Data

General data

Article number 2501288



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24

Page 1/3

Connection cable voltage

For devices of the IKI series and ohmic sensors

General data

Quantity unit	Piece
Product designation	Y-cable IKI to CAPDIS-PI-RR4 1.5 m 2 x system plug

More technical data

Usable with	IKI-22, IKI-23, IKI-50
Version cable	Screened connecting wire

Dimensions and type of installation

Total length L	2 m
----------------	-----

Operating conditions

Operating temperature	-25°C ... 55°C
Storage temperature	-30°C ... 75°C

Connection to CAPDIS	Micro Mate-N-Lok plug
Connection to IKI	Micro Mate-N-Lok plug



Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

22.08.24


Page 2/3

© Kries Energietechnik GmbH & Co. KG | Subject to modifications.

Connection cable voltage

For devices of the IKI series and ohmic sensors

Drawing

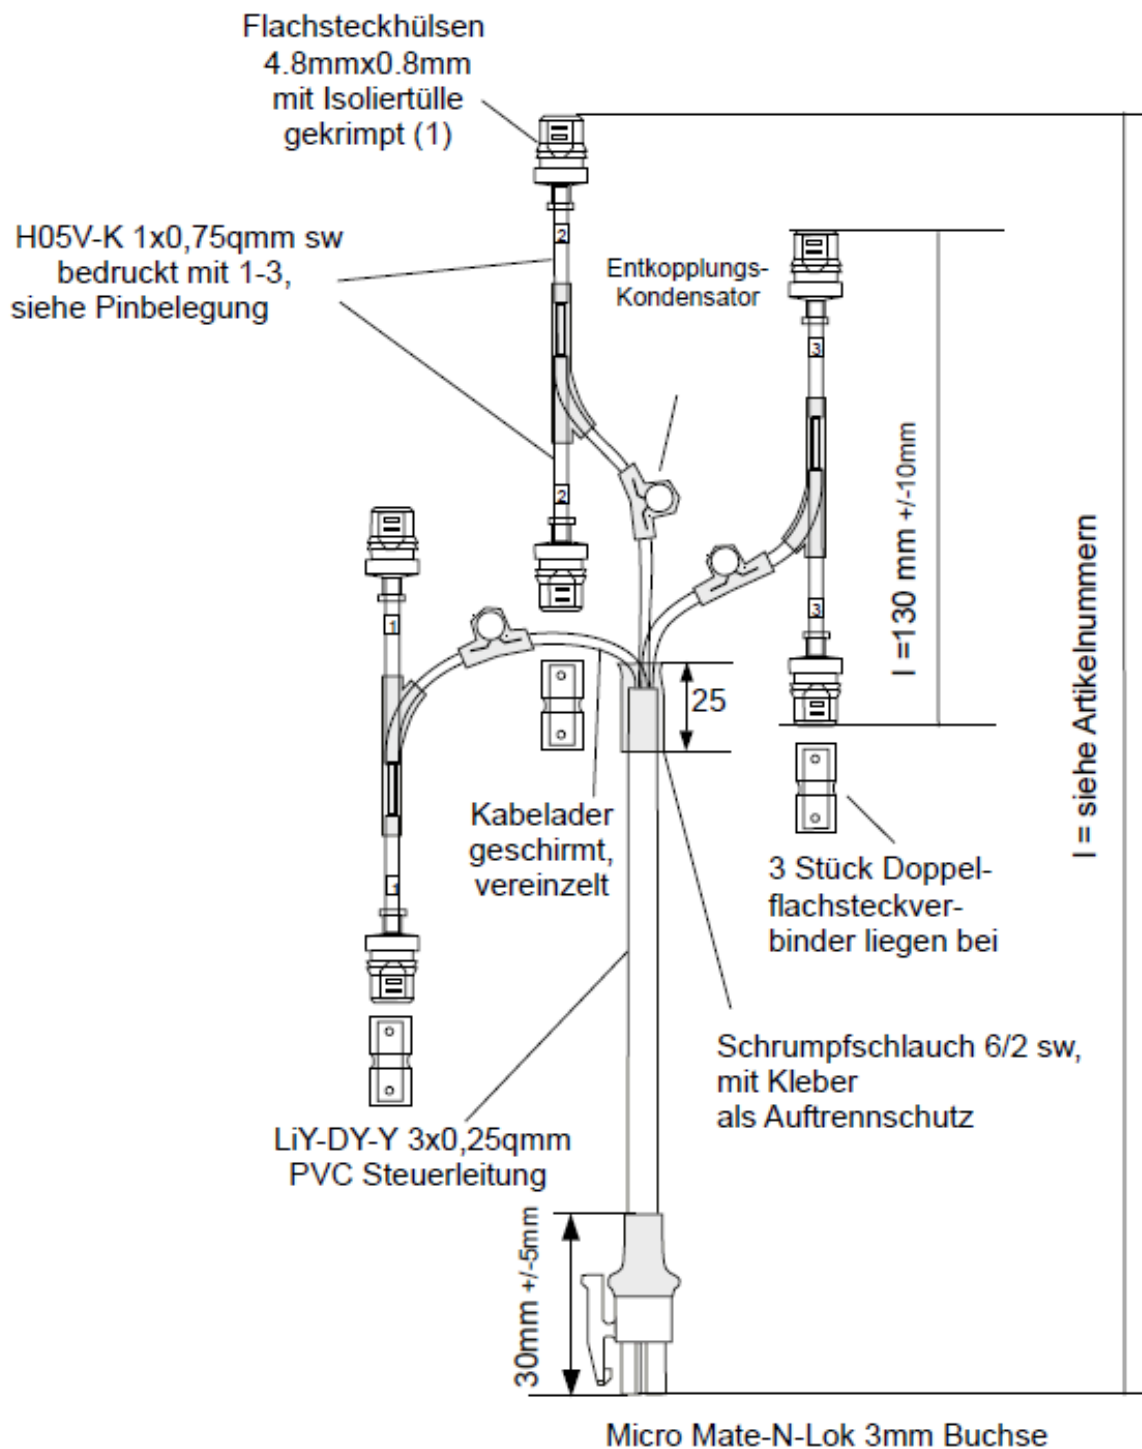

Kries Energietechnik GmbH & Co. KG

Sandwiesenstr. 19 | D-71334 Waiblingen

kries.com | sales.kries@te.com | (+)49-7151-7074-860

© Kries Energietechnik GmbH & Co. KG | Subject to modifications.

22.08.24

Page 3/3